


KEY NOTES:

1. 12" CMU AND FACE BRICK WITH 1" RIGID INSULATION
2. 3' SQUARE ALUM. ACCESS HATCH WITH ALUM. ACCESS LADDER (TYPICAL)
3. 2' SQ. x 2' DEEP SUMP WITH SUMP PUMP
4. 30" DIAMETER VENTURI TUBE W/ ELECTRIC OPERATED BUTTERFLY VALVE FOR RATE OF FLOW CONTROLLER
5. 1 1/2" DIA. ALUM. HANDRAIL
6. 5000 GALLON POLYMER STORAGE TANK, 8'-6" DIAMETER x 12'-8" TALL
7. 9000 GALLON FERRIC SULFATE STORAGE TANK, 11'-9" x 12'-2" TALL
8. 9000 GALLON DEL PAC STORAGE TANK, 11'-9" x 12'-2" TALL
9. 500 GALLON DAY TANK WITH SCALE, 48" DIA. x 73" TALL
10. 5000 GALLON FLUORIDE STORAGE TANK, 8'-6" DIAMETER x 12'-8" TALL
11. 5000 GALLON CAUSTIC STORAGE TANK, 8'-6" DIAMETER x 12'-8" TALL
12. 12,500 GALLON MIXED OXIDANT STORAGE TANK.
13. 50 GALLON DAY STORAGE TANK
14. SUMP WITH PUMP

GENERAL NOTES:

- ADDITIONAL DETAIL FOR EACH CHEMICAL ROOM ARE FURTHER OUTLINED IN SUBSEQUENT SHEETS. SHEE SHEET _____ AND ____ FOR MORE INFORMATION

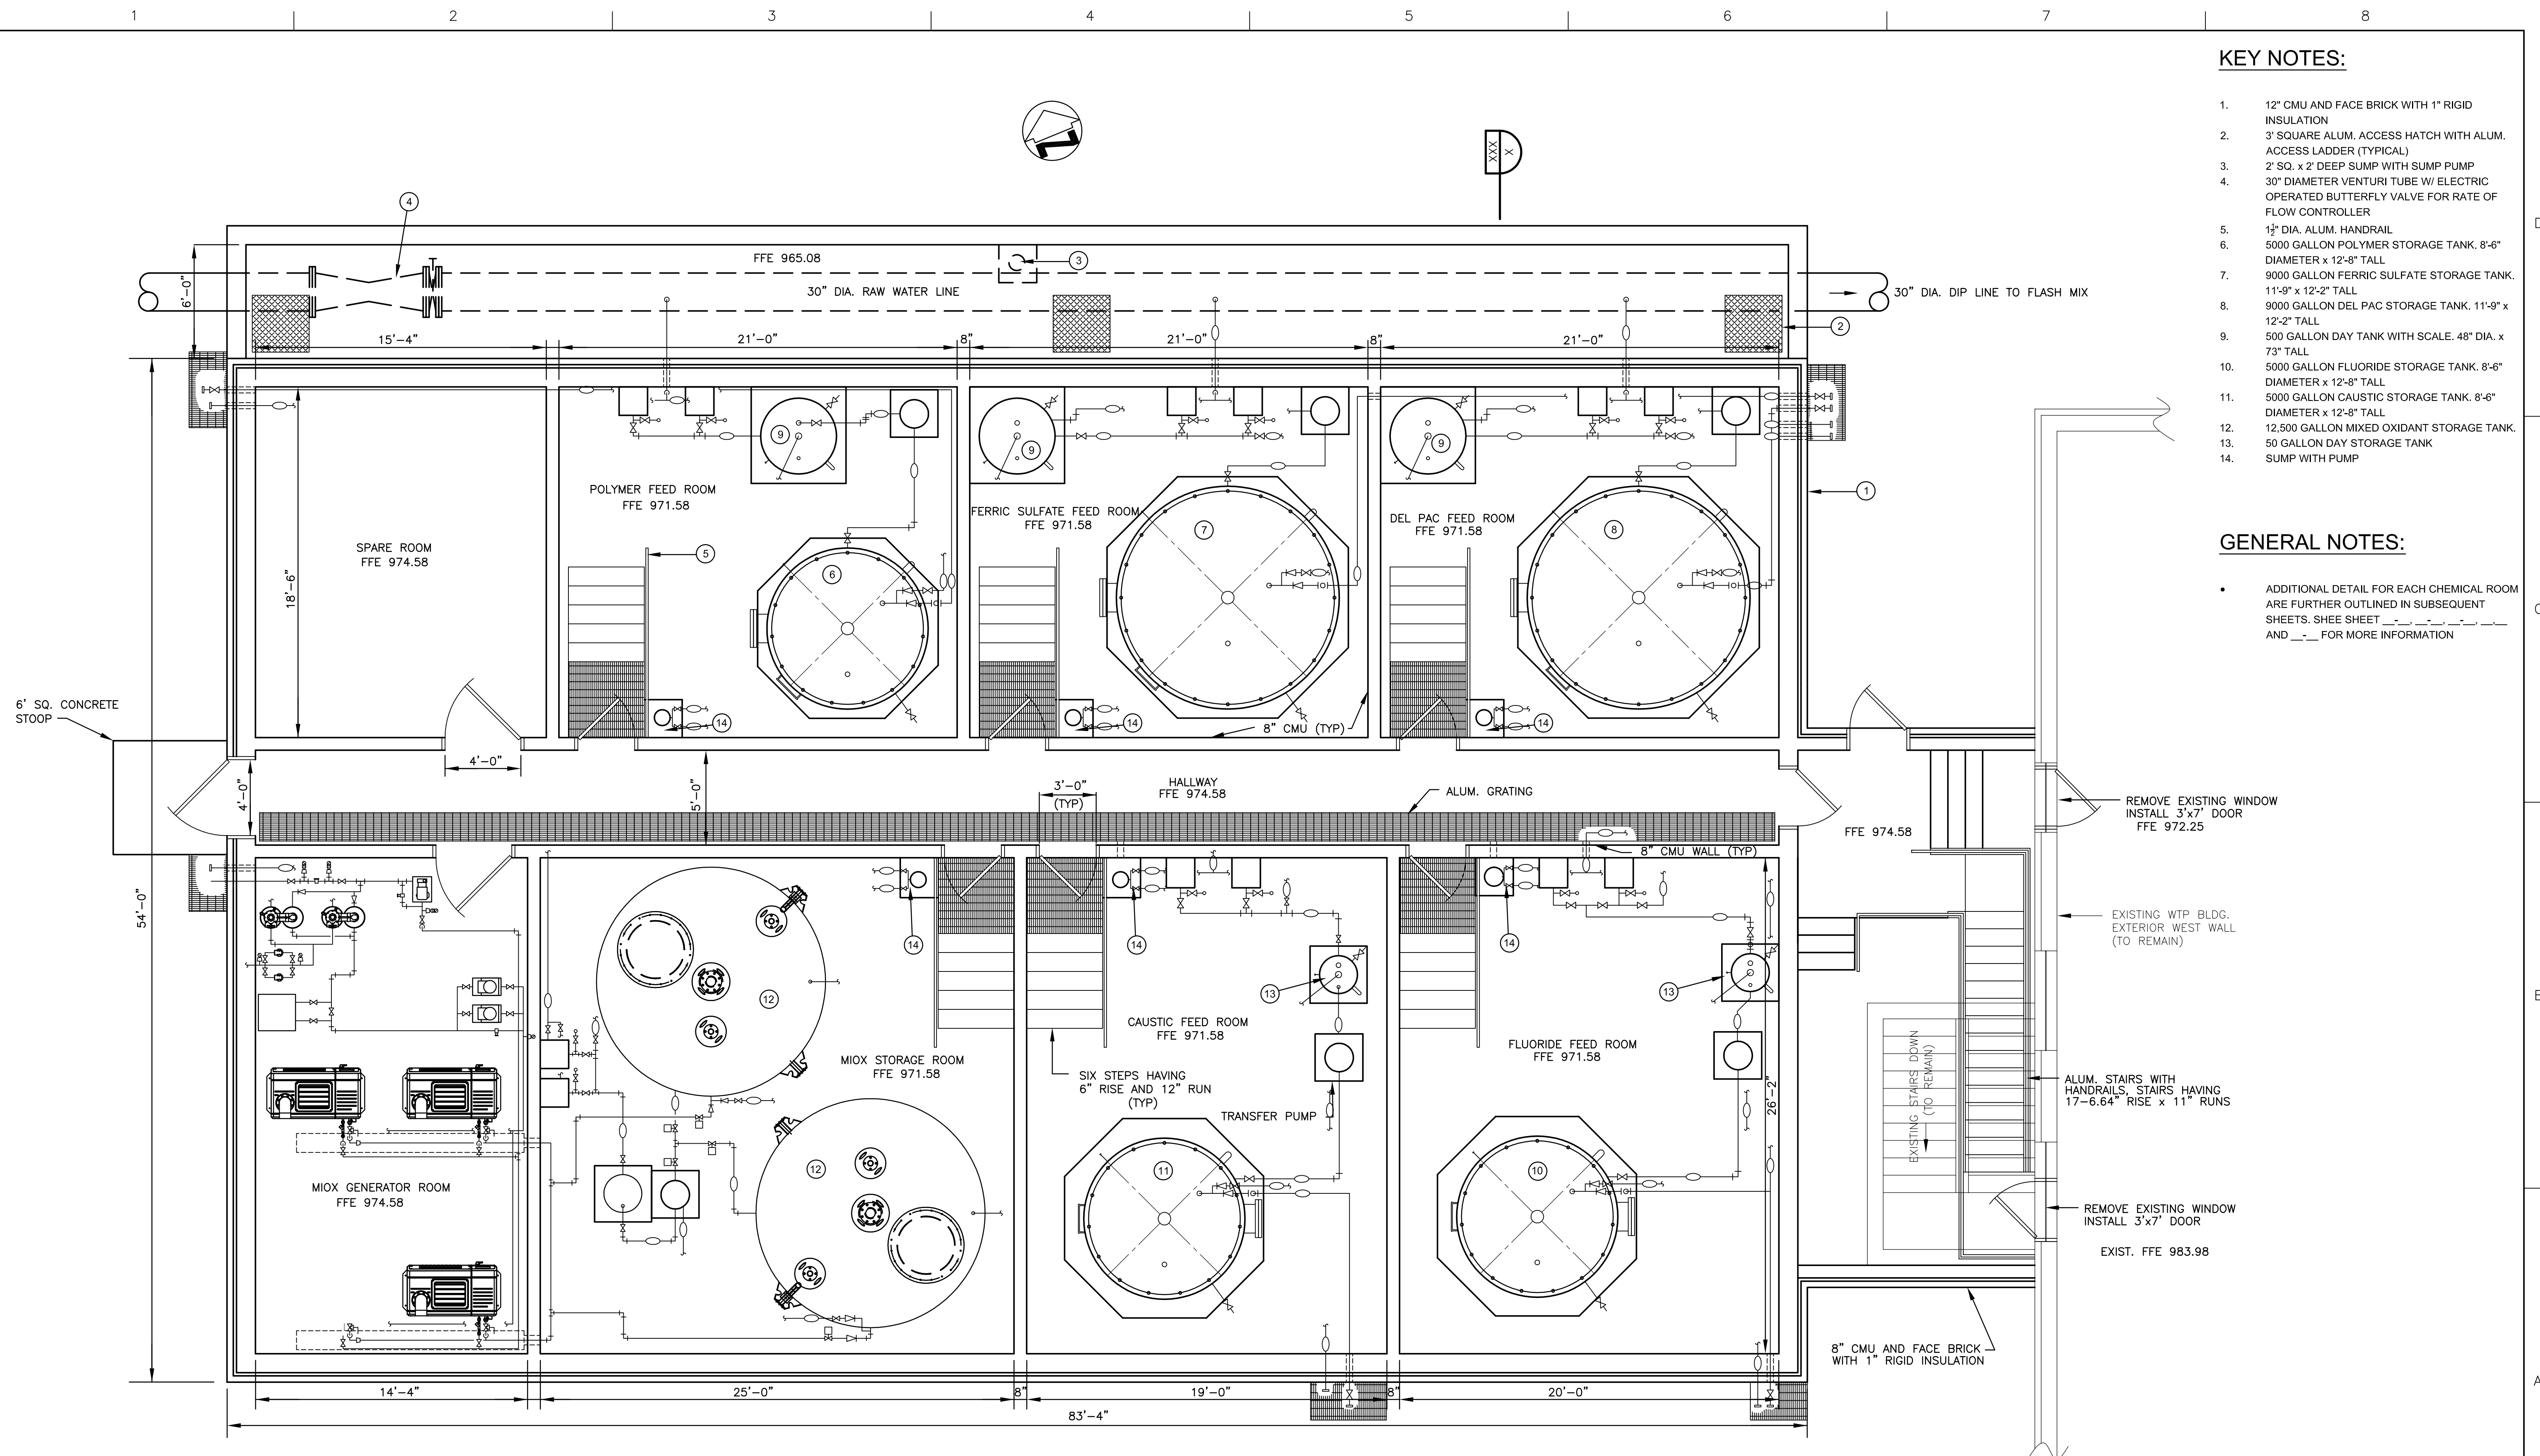


PLAN
1/4" = 1'-0"



ISSUE	DATE	DESCRIPTION
A	-	-

PROJECT MANAGER	-
DESIGNED	-
DRAWN	-
CHECKED	-
QA/QC	-
PROJECT NUMBER	173077

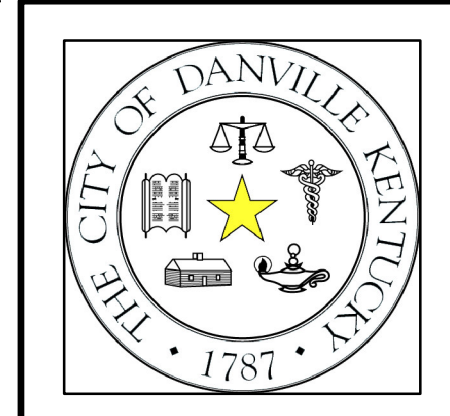

**WATER TREATMENT
PLANT IMPROVEMENTS
DANVILLE, KY**

**PROCESS
CHEMICAL BLDG. PLAN**

FILENAME: 05D101-X.dwg
SCALE: -

SHEET
05D101-X